

- New fault annunciation according to DIN 19235
- Expandable from 3 up to 303 inputs
- Width 45 mm


Fault annunciator AD 5998:

- 3 inputs
- Pushbutton connection possible for light signal acknowledgement, horn acknowledgement and lamp test
- 1 relay for common alarm and 1 for horn

Extension unit AD 5992:

- 6 inputs

Function Diagram

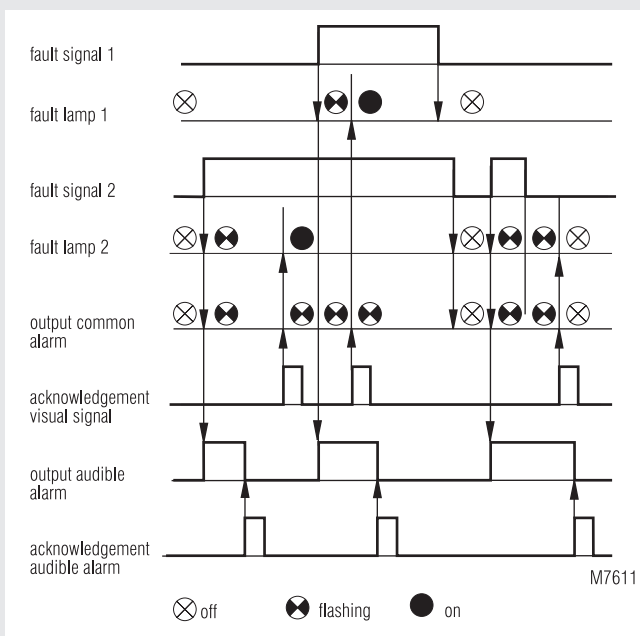


Approvals and Markings



Applications

Monitoring of industrial plants and buildings

Circuit Diagrams

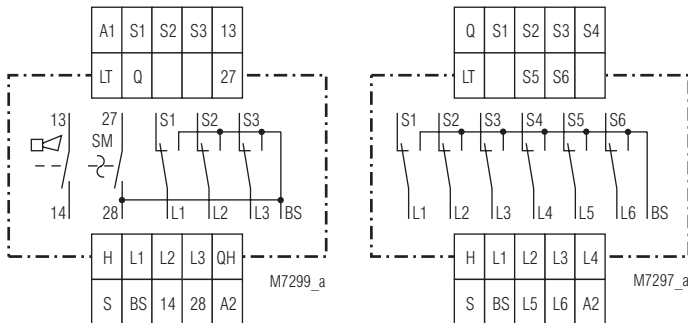

AD 5998

AD 5992

Connection Terminals

Terminal designation	Signal designation
A1	+ / L
A2	- / N
S1, S2, S3, S4, S5, S6	Measuring inputs for fault signals
L1, L2, L3, L4, L5, L6	Fault signals outputs
QH	Control input for horn acknowledgement
Q	Control input for light signal acknowledgement
LT	Control input for lamp test
13, 14	Relay output for horn
27, 28	Relay output for common alarm
H	Bus wire horn
S	Bus wire for common alarm
BS	Flash impulse

Notes

The connections A1, inputs S1-S3 and S1-S6, lamp test input LT and acknowledgement input Q have to be connected to the same phase.

Even if no common signal light will be connected, the nominal voltage is to be connected to terminal 27.

The bus-lines H and S have a low voltage and are not allowed to be connected to any external voltage. If inductive or capacitive superimposed voltages are expected, it is recommended to use screened cables for these lines.

The flash impulse via flash line BS will be generated by an internal contact. The maximum load of this contact must be observed (technical data).

It is not allowed to connect lamps with transformers on the outputs. This would cause unintentional fault signals at the lamp test.

In case of units with AC-voltage, the signal lights during the lamp test are lighting dim, as the test will be effected only with a half-wave. The half-wave voltage is also applied at terminals S1-S3 and S1-S6 during the lamp test.

If other lamps, except for the fault signal lamps, should be tested via the lamp test pushbutton T1, it is necessary to use a lamp tester, whose diode configuration is identically to the diode configuration of the fault annunciator. In case of AC-voltage operation this is the lamp tester AI 990/04, in case of DC-voltage operation the lamp tester AI 990 or AI 990.10.

Technical Data

Input

Nominal voltage U_N : AC 24, 230, 240 V,
DC 24 V with polarity protection
AC 42, 110, 127 V on demand
with additional resistors
(see connection example)

Special voltages:

	AD 5998		AD 5992
	RV	R1	R2
DC 48 V:	ZWS 8 sl 390 Ω	ZWS 8 sl 2,7 k Ω	ZWS 8 sl 430 Ω
DC 60 V:	ZWS 8 sl 640 Ω	ZWS 20 sl 4,7 k Ω	ZWS 8 sl 640 Ω
DC 110 V:	ZWS 20 sl 1,5 k Ω	ZWS 20 sl 10 k Ω	ZWS 20 sl 1,5 k Ω
DC 125 V:	ZWS 20 sl 1,8 k Ω	ZWS 20 sl 12 k Ω	ZWS 20 sl 1,8 k Ω
DC 230 V:	ZWS 20 sl 3,3 k Ω	ZWS 20 sl 24 k Ω	ZWS 20 sl 3,3 k Ω

Voltage range: 0.8 ... 1.1 U_N
Nominal consumption: AC 230 V DC 24 V
6 VA 1.5 W
Nominal frequency: 50 / 60 Hz
Fault impulse time: \geq 100 ms
Acknowledgement impulse time: $>$ 200 ms

Output

Loading:

AD 5992 / AD 5998
signal light each: AC 230 V 1 A max.
(terminals L1, L2, L3, L4,
L5, L6 bzw. L1, L2, L3)

AD 5998
Audible-alarm output
(terminal 14): AC 230 V 3 A max.
Common alarm output
(terminal 28) and lamp signal
via flash line BS totally: AC 230 V 3 A max.
DC 24 V 2 A max.

Lamp test (pushbutton 1): Sum of the currents of all lamp signals L
for higher switching capacity
a contactor is to be inserted

Technical Data

General Data

Operation mode: Continuous operation

Temperature range

Operation: - 20 ... + 60°C

Storage: - 20 ... + 60°C

Altitude: $<$ 2,000 m

Clearance and creepage distances

rated impulse voltage /

pollution degree: 4 kV / 2 IEC 60 664-1

EMC

Electrostatic discharge: 8 kV (air) IEC/EN 61 000-4-2

HF-irradiation

80 MHz ... 1 GHz: 10 V / m IEC/EN 61 000-4-3

1 GHz ... 2,7 GHz: 3 V / m IEC/EN 61 000-4-3

Fast transients: 2 kV IEC/EN 61 000-4-4

Surge voltages: 1 kV IEC/EN 61 000-4-5

Interference suppression: Limit value class B EN 55 011

Degree of protection:

Housing: IP 40 IEC/EN 60 529

Terminals: IP 20 IEC/EN 60 529

Housing: Thermoplast with V0 behaviour

according to UL subject 94

Vibration resistance: Amplitude 0.35 mm,

frequency 10...55Hz IEC/EN 60 068-2-6

20 / 060 / 04 IEC/EN 60 068-1

Climate resistance: EN 50 005

Terminal designation:

Wire connection:

2 x 2.5 mm² solid or

2 x 1.5 mm² stranded wire with sleeve

DIN 46 228/-1/-2/-3/-4

Flat terminals with self lifting

clamping piede IEC/EN 60 999-1

0.8 Nm

Fixing torque:

Mounting:

DIN rail IEC/EN 60 715

Weight

AC 230 V DC 24 V

AD 5998: 380 g 250 g

AD 5992: 360 g 220 g

Dimensions

Width x height x depth: 45 x 77 x 127 mm

Standard Types

AD 5998 AC 230 V 50/60 Hz

Article number: 0032367

• Nominal voltage U_N : AC 230 V

• Width: 45 mm


AD 5992 AC 230 V 50/60 Hz

Article number: 0032361

• Nominal voltage U_N : AC 230 V


• Width: 45 mm

Ordering Example


AD 5998 AC 230 V 50/60 Hz


 _____ Nominal frequency
 _____ Nominal voltage
 _____ Type

Connection Examples

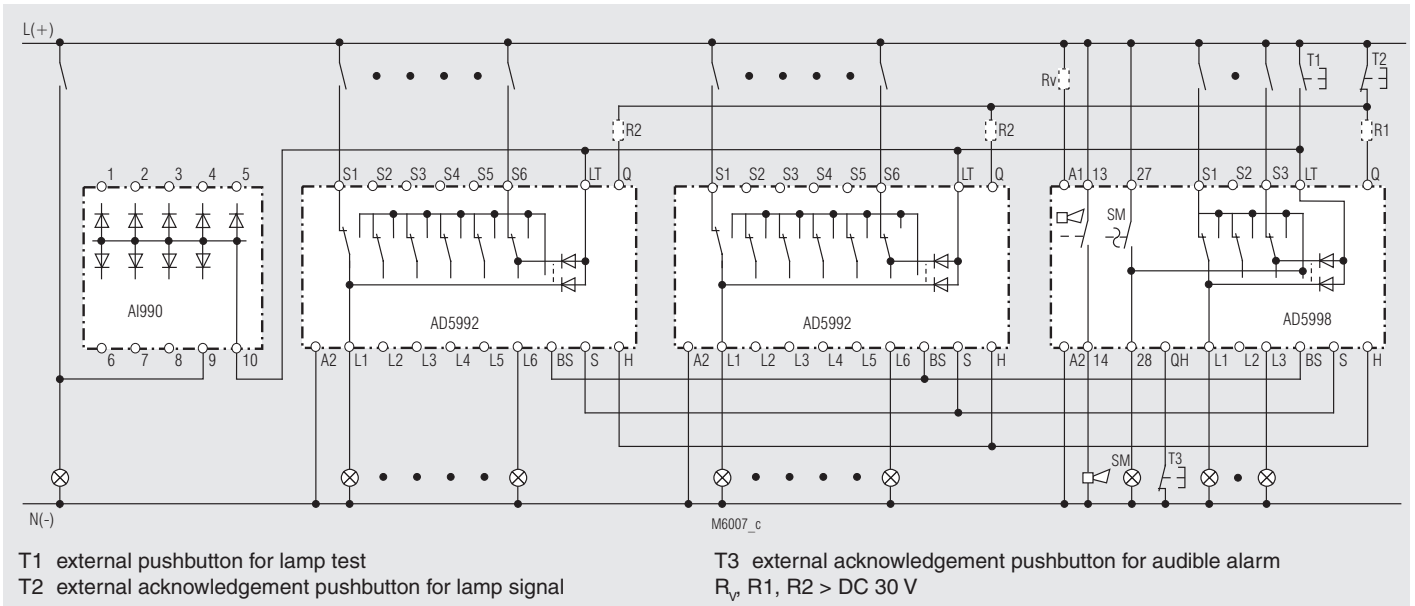

Connection diagram AD 5998 - AD 5992 for operation at DC-voltage with additional lamp tester AI 990 or AI 990.10
Lamp tester AI 990 is only required if additional lamps in the system need to be tested.

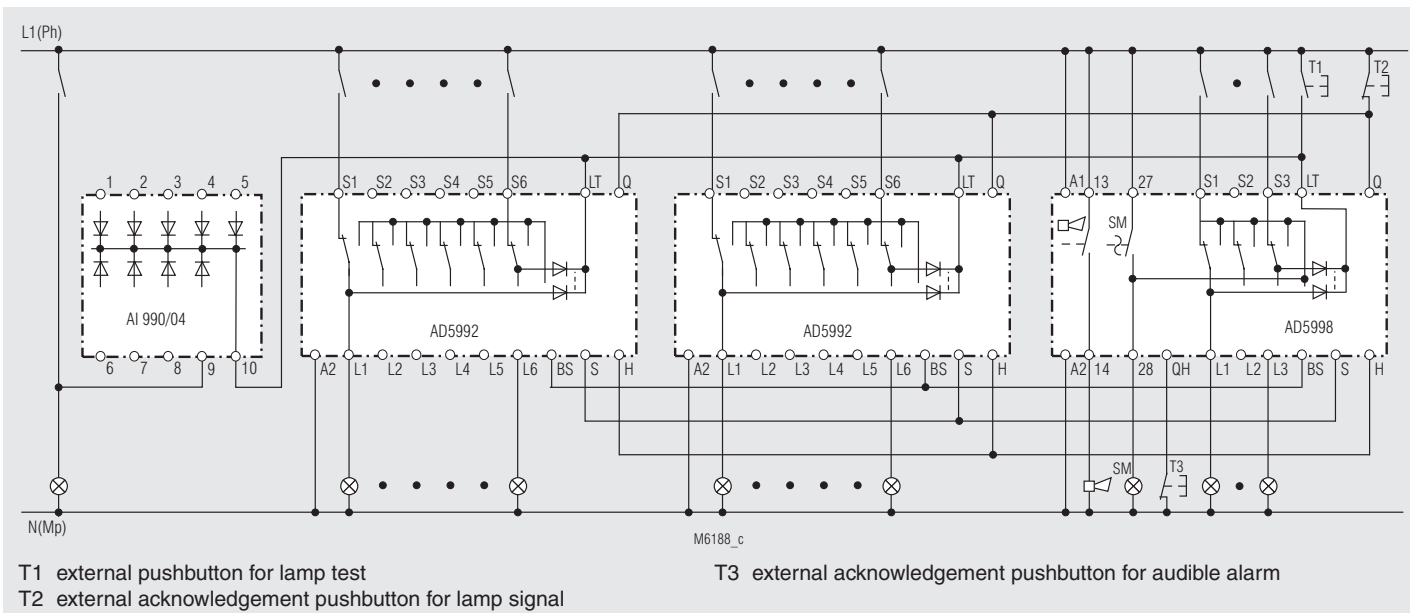

Connection diagram AD 5998 - AD 5992 for operation at AC-voltage with additional lamp tester AI 990.04 or AI 990.12
Lamp tester AI 990 is only required if additional lamps in the system need to be tested.

