


**8. Ordering number baelz 6490 / baelz 6590**

Examples : 6490 / 0 - 2.4 - 230 - 00.0  
 6590 / 3 - 2.2 - 115 - S7.1

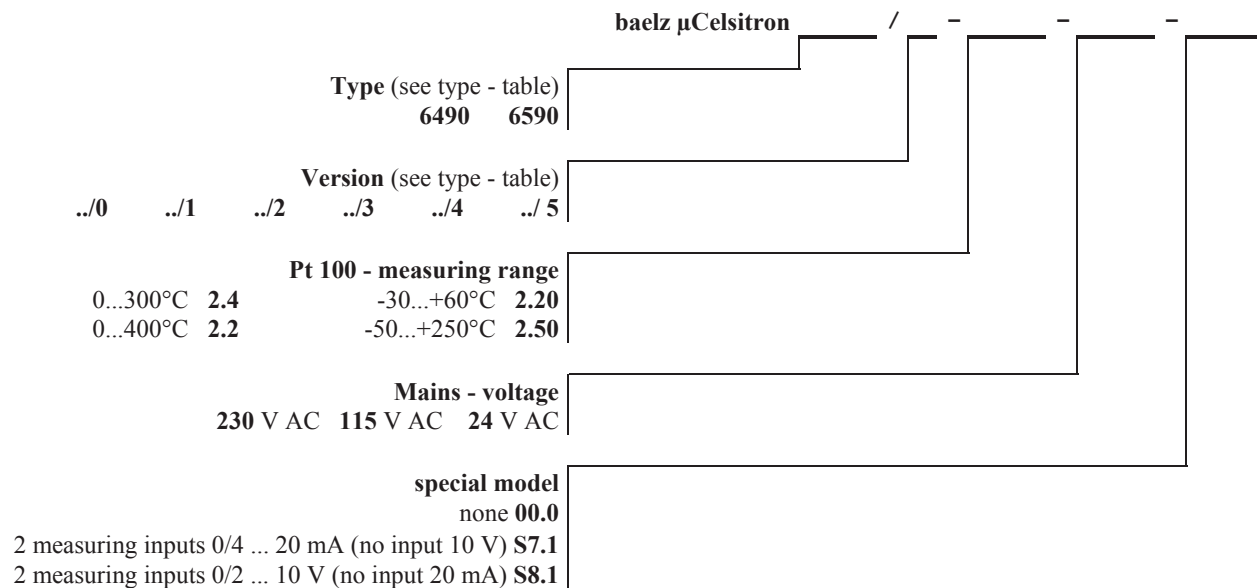

Type / version 6490.. and 6590..	./0	./1	./2	./3	./4	./5
<b>Equipment:</b>						
<b>PI(D) - three - position step -output</b>	✓	✓	✓	✓	✓	✓
<b>Alarm relay 1</b>	✓	✓	✓	✓	✓	✓
<b>1 measuring input Pt100</b>	✓	✓	✓	✓	✓	✓
<b>1 measuring input 0 / 4 ... 20 mA</b>		✓	✓	✓	✓	✓
<b>1 measuring input 0 / 2 ... 10V</b>		✓	✓	✓	✓	✓
<b>Measuring transducer feed voltage 24 V DC</b>		✓	✓	✓	✓	✓
<b>1 digital input (external setpoint)</b>		✓				✓
<b>4 digital inputs (open, close, stop, setpoint 2)</b>				✓	✓	
<b>5 digital inputs (open, close, stop, ext. setpoint, setpoint 2)</b>			✓			
<b>1 Pt100 - process variable output 0...+10V</b>			✓		✓	✓
<b>1 Interface RS485 (MODBUS RTU)</b>				✓	✓	
<b>Alarm relay 2</b>				✓	✓	✓