

Absolute, Non-Contact Position Sensors

L-Series Analogue + Digital

Temposonics® LD
Measuring range 50 - 5000 mm




A Compact Sensor for Hydro Cylinders

- Absolute Sensor
- Non-contact Measurement
- Modular Construction
- Stable Design
- Highest Durability
- Measuring Range: 50 - 5000 mm
- Linearity: Better 0,02 %
- Repeatability: 0,001 %
- Direct Analogue Output (V/mA): 100% field adjustable
- Digital Pulse Output, Start-Stop

Temposonics-LD

Analogue + Digital

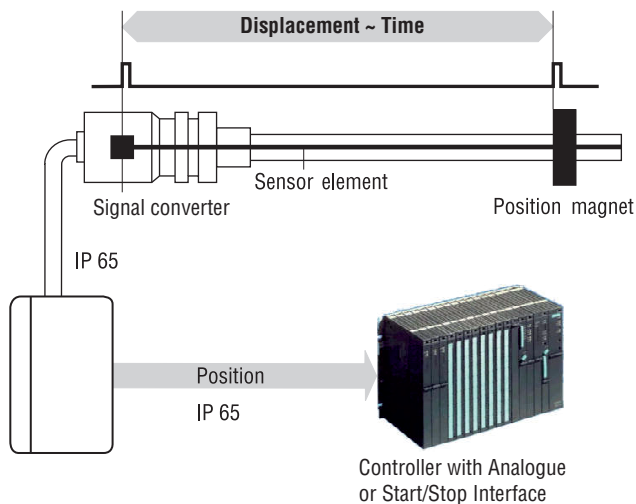

The absolute Temposonics® linear position sensors are based on the MTS developed magnetostrictive measurement principle. That combines various magneto-mechanical effects and uses the physical high precise speed-measurement of an ultrasonic wave (torsion pulse in its sensor element) for position detecting. The integral signal processing transforms the measurements into analogue or digital standardized outputs.

The *contactless* principle - an external movable magnet marks the position - eliminates the wear, noise and erroneous signal problems and guarantees the best durability without any recalibration.

Measured Variables Measuring Range Output

Displacement
50 - 5000 mm
Voltage: 0...10 VDC or 10...0 VDC
(Minimum load: > 5 kOhm)
Current: 4(0)...20 mA or 20...4(0) mA
(Min/Max. 0 / 500 Ohm)

Adjustment of NULL and SPAN Resolution

Start/Stop pulse: RS422 Differential signal
Analogue: 100% of measuring range (F.S.)
Analogue: Infinite, restricted by output ripple
Digital: 0,1 mm; 0,01 mm (controller depending)

Linearity Repeatability Update Frequency Connection Type Input Voltage Current Drain Ripple Temperature Coefficient Electric Strength Operating Temperature Dew Point, Humidity EMV-Test

< ± 0,02 % F.S. (Minimum ± 50 µm)
< ± 0,001 % F.S.
Analogue: 1kHz / Digital: controller dependent
Cable outlet
24 VDC (-15 / +20 %)
100 mA typical
< 1 % peak to peak
< 40 ppm/ °C
500 V (DC ground to machine ground)
-40 °C...+75 °C
90 % rel. humidity, no condensation
Electromagnetic emission EN 50081-2; Electromagnetic immunity EN 50082-2
EN 6100-4-2/3/4/6 Level 3/4 Criteria A,
LD-sensor installed in a ground metal housing

Shockrating Vibration Rating Mounting Magnet speed Sensor rod + flange - Pressure Rating Sensor Electronic Housing Sealing Sensor Installation Magnet Type

100 g, 6 ms / IEC-Standard 68-2-27
10 g, 10 - 2000 Hz / IEC-Standard 68-2-6
Any orientation
Any
Stainless steel 1.4301 / AISI 304
350 bar, 700 bar peak pressure
Aluminium diecasting housing
IP 65
Fitting flange or thread M18 x 1,5
Ring magnet

Temposonics®-LD



The compact position sensor system was designed for installation in hydraulic cylinders, specifically for use in standard clevis head cylinders or any space limited cylinder applications.

- The pressure proof stainless steel sensor rod with fitting or threaded flange protects the sensing element in which gives rise to the measurement signal. It fits into the bored piston rod.

- The external standard industrial housing accommodates the modular electronic interface with active signal conditioning. The sensor electronic is connected to the basic sensor via inside terminal screws and to the controller with integrated cable outlet.

- The position magnet, the only moving part is mounted on the piston bottom. The permanent magnet travels wearfree and contactless along the stationary sensor tube. Its magnetic field starts the measurement signal through sensor's rod wall.

LD with fitting flange

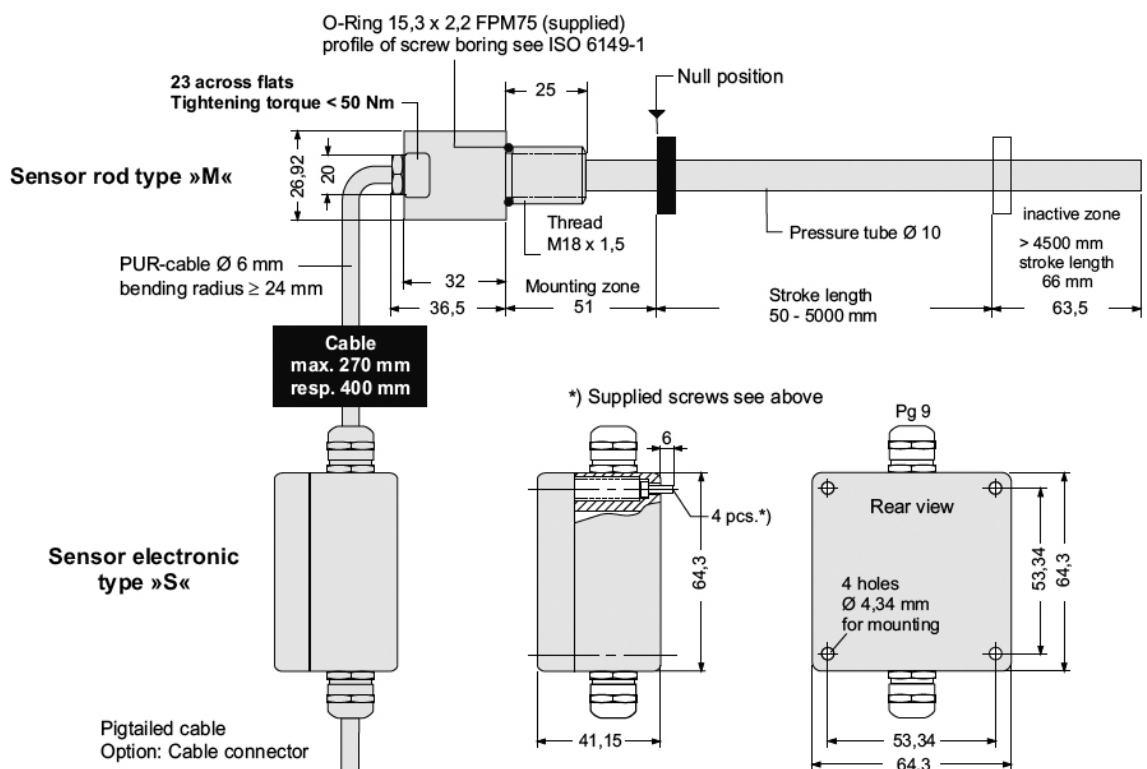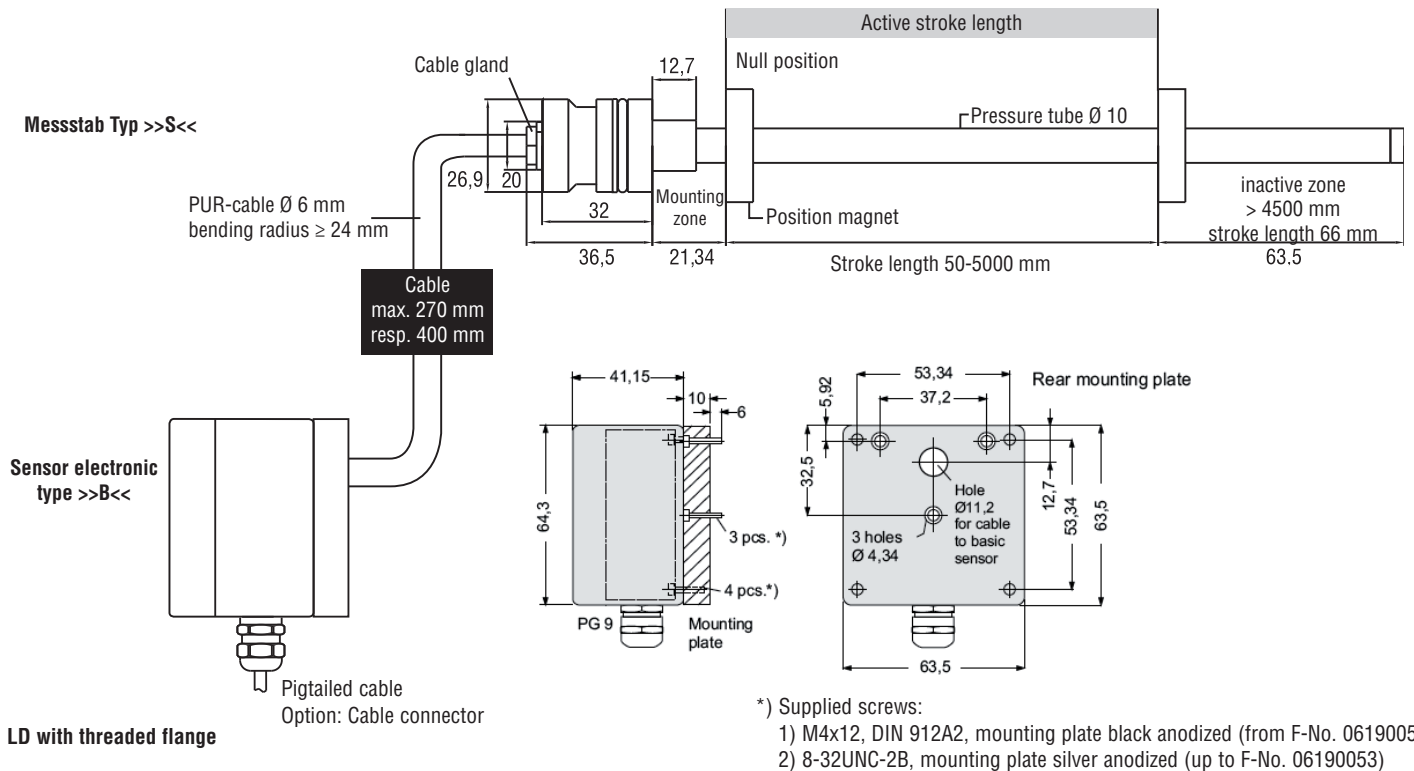


Temposonics-LD

Analogue + Digital


Analogue Output

Temposonics® LD sensors provide direct analogue outputs, including voltage (0-10 V) and current (4-20 or 0-20 mA), forward and reverse acting. Resolution is only limited by the output ripple. Since the outputs are direct, no signalconditioning electronics are needed when interfacing with controllers or meters.

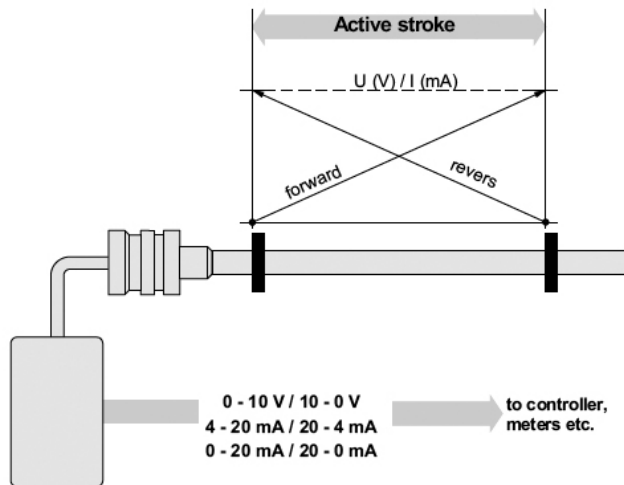

Digital Start/Stop pulse

Digital LD sensor is equipped with a start/stop output. The sensor requires a start signal from an external indicator in onsite control system and returns a signal, corresponding to the magnet position. The time elapsed between the two signals is proportional to the magnet position, i.e. to the displacement. Time measurement is by the indicator and used for calculating the position value. Generation and evaluation of the start/stop pulse is made by a customized Start/Stop interface module of many controller companies.

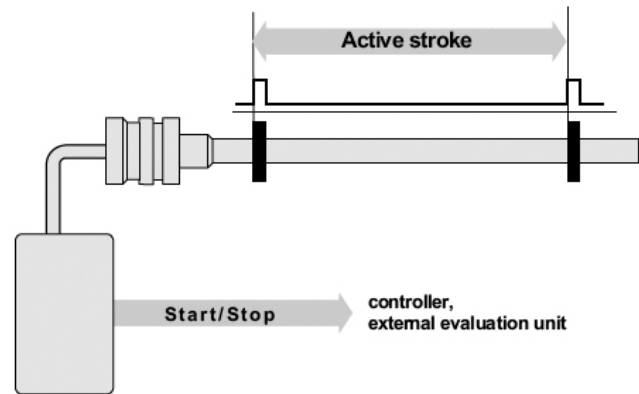

Sensor field programming

LD sensors are preconfigured at the factory by model code designation. If needed, MTS offers different external service tools for modifying sensor parameters inside the **active electrical stroke** (50 mm minimum clearance between setpoints) via the standard connection cable. There is no need to open the sensors electronics.


Following tools are available:

1. Handheld-Programmer G-Analogue

for setups of measuring length inside the ordered output by pushing up/down-buttons.



Logic diagram Start/Stop

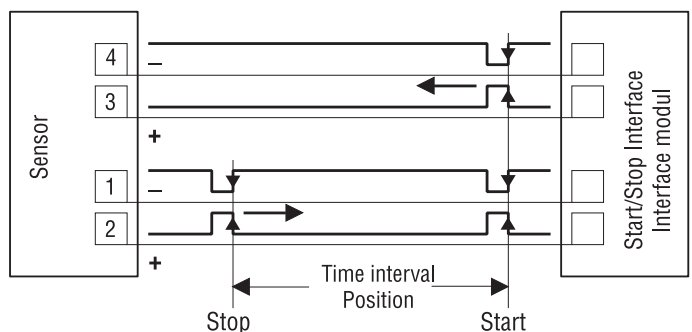

2. PC-Programmer G-Analogue

This hardware converter is required to communicate via serial port of Windows PC to the sensor. Customized settings are possible by using a MTS programming software (CD-ROM) for:

1. Null and Span
2. Forward and reverse acting
3. Output: Voltage/Current output values encl. range

Cylinder installation

Temposonics® LD is designed for installation into hydraulic cylinders. Mounting of a LD sensor requires the use of a O-ring (black) and a backup-ring (orange). Both are supplied with the sensor. The sensor will be fixed via special screw.

Interconnection cable
When mounted in the manner as shown below, interconnection cable is shielded according to EMC standard at the cylinder end cap. However, when the LD sensor is mounted in an alternative way, proper care must be taken to shield the interconnection cable.


When installing the sensor in the cylinder notice following:

- Magnet must not slide along the sensor tube.
- The bore in the piston rod and type of sealing ate determined by cylinder manufacturers as that depend on hydraulic pressure and piston velocity. We recommend 13 mm bore diameter at minimum. Do not exceed peak pressure.
- Protect sensor rod from wear.


Mounting ring magnet

For accurate position measurements mount the magnet with non-magnetizable material (screws, etc.).


Rod style »S« with Electronics Housing style Typ »B«

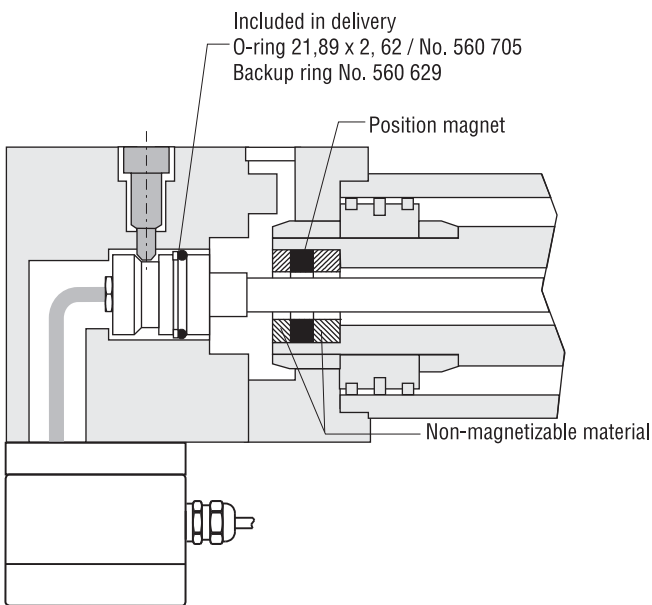


Example mounting detail:
Setscrew 8 M6 - ISO 7379 with internal hexagon

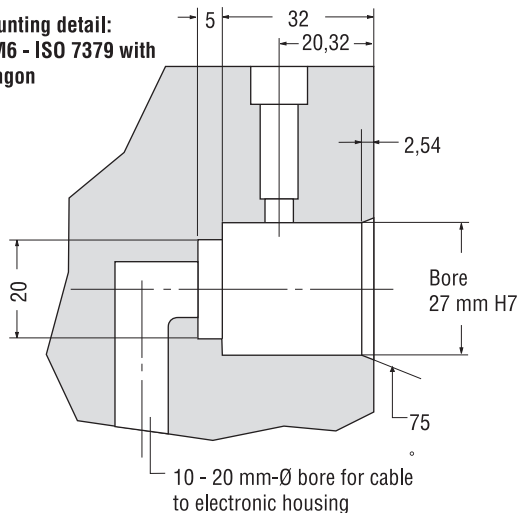


Monting Sensor electronic type »B«

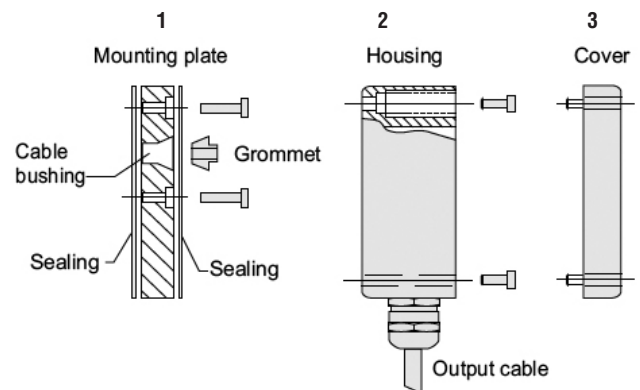

Minimum tolerances for magnetizable material

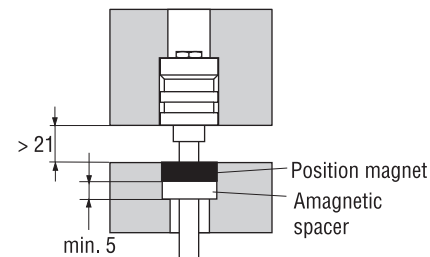


Detail: Flange

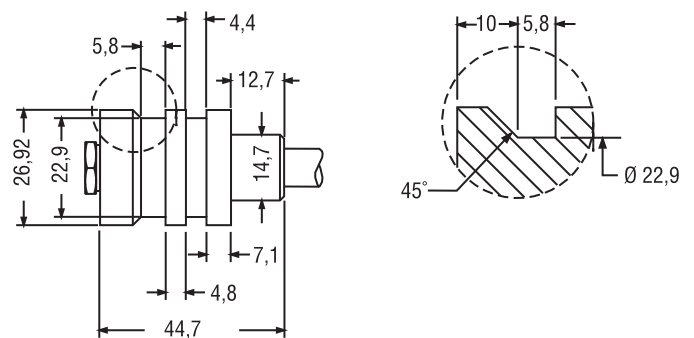

ATTENTION

Only the mounting of sensorsystem as shown here fullfill the EMC standards of Electromagnetic Emission and Immunity.

Sensor Electronics Housing

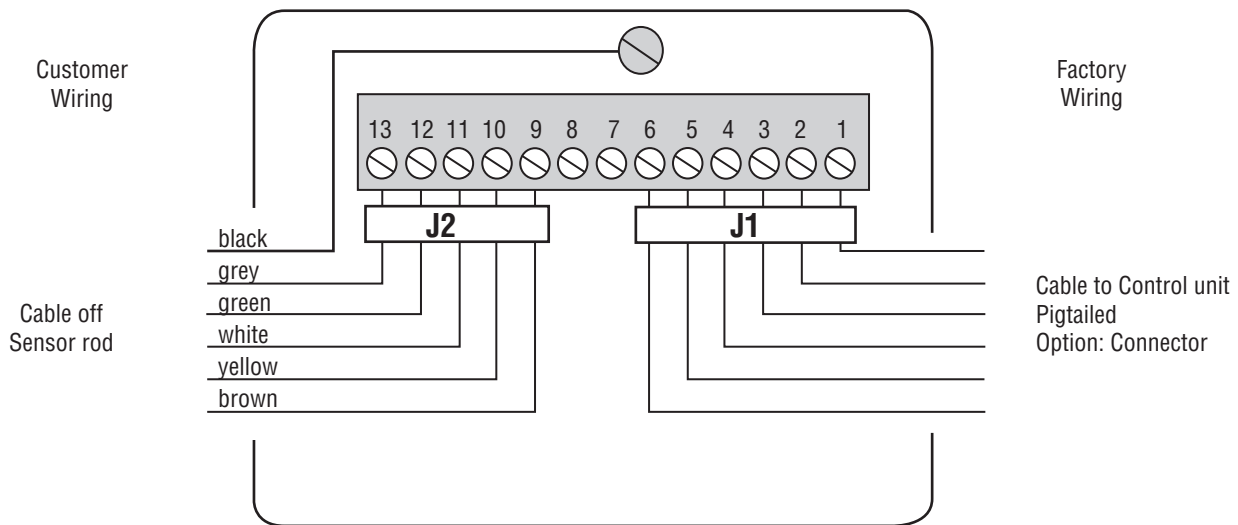


Terminal	Colour	Function
9	brown	V in
10	yellow	SE out
11	white	GND
12	green	WG (-)
13	grey	WG (+)
Screw	black	Frame GND


! For side entry housing connect shield on EMC cable gland

Cable gland PG 9-EMC

EMC standard screwed cable gland for shielded cable. Simply to handle, as the cable shield must be removed backup over the plastic insert.

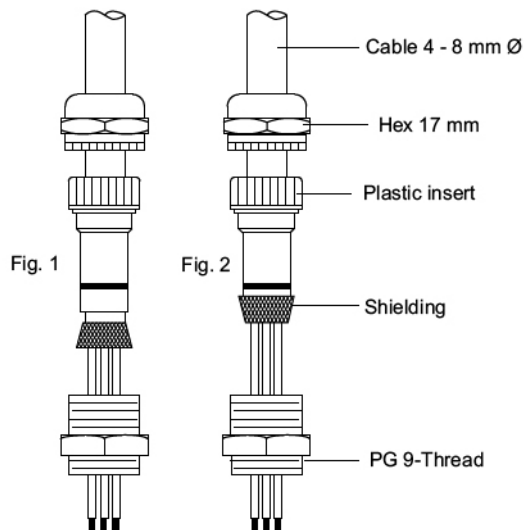

Typical 4 - 20 mA wiring

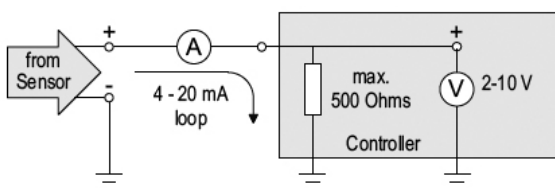

1. Start/Stop Output

Terminal	Colour	Function	Option: Connector
1	white	DC Ground (0 V)	Pin 6
2	pink	Stop (+)	Pin 2
3	yellow	Start (+)	Pin 3
4	grey	Stop (-)	Pin 1
5	green	Start (-)	Pin 4
6	brown	+24 VDC	Pin 5




2. Analogue Output

Terminal	Colour	Function	Option: Connector
1	white	DC Ground (0V)	Pin 6
2	pink	DC Ground	Pin 2
3	green	PC Programmer only	Pin 4
4	grey	0-10, 10-0 V, 4(0)-20, 20-(0)4 mA	Pin 1
5	yellow	PC Programmer only	Pin 3
6	brown	+24 VDC	Pin 5



! Wiring of 10-0 V and 20-4(0) mA outputs is valid for LD sensors from fabrication # (F-No.) 0546 xxxx.

Typical Grounding

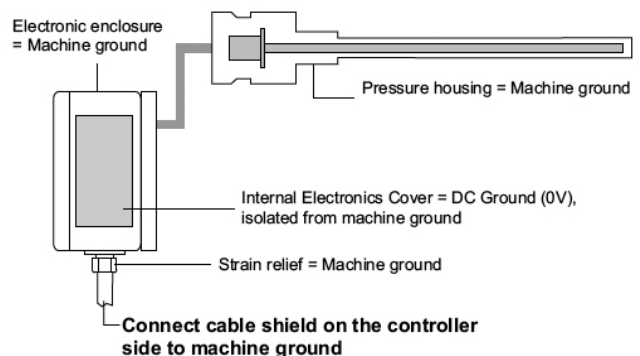

! Cable shield and DC Ground have to be isolated separately!

Temposonics® LD

Sensor rod style

- S** - Fiting flange (with housing »B« only)
M - Threaded flange (with housing »S« only)

Sensor electronic housing style

- B** - Bottom cable entry
S - Side cable entry

Cable type electronic housing

- R** - PVC-cable
H - PUR-cable

Cable outlet

- PT** - Pigtailed
D6 - Cable with 6 pin male connector

Cable length, electronic housing

- 02** - 2 meters, Standard
01-10 - 01 up to 10 meters

Measuring length

- 0050 - 5000 mm
 (up to 1000 mm in 50 mm steps; up to 5000 mm in 250 mm steps; **Option:** In 5 mm steps)

Input voltage

- 2** - +24 VDC

Output signal

- R0** - Start/Stop
V8 - 0-10 V
V9 - 10-0 V
A4 - 4-20 mA
A5 - 20-4 mA
A6 - 0-20 mA
A7 - 20-0 mA

Integral cable length of Sensor rod


- L1** - 270 mm
L2 - 400 mm

Lieferumfang:

- Messstab
- Sensorelektronik


**Magnete und Zubehör
 bitte extra bestellen.**

Position magnets (order seperately)




Ring magnet OD33
Part No. 201 542-2

Composite PA-Ferrite-GF20
 Weigth ca. 14 g
 Operating temperature:
 -40 ... +100°C
 Surface pressure max. 40 N/mm²
 Fastening Torque for M4 screws max. 1 Nm



U-Magnet OD33
Part No. 251 416-2


PA-Ferrit-GF20
 Weigth ca. 11 g
 Operating temperature:
 -40 ... +100°C
 Surface pressure max. 40 N/mm²
 Fastening torque for M4 screws max. 1 Nm



Ring magnet OD25,4
Part No. 400 533

Composite: PA-Ferrite
 Weigth ca. 10 g
 Operating temperature:
 -40 ... +100°C
 Surface pressure max. 40 N/mm²


Male connector M16 wired on cable



6 pin DIN male connector
Part No. 370 372

Housing: Zinc, nickel plated
 Termination: Solder
 Contact insert: Silver plated
 Cable clamp: PG 7
 Cable-Ø: 6 mm

Mating female connector M16



6 pin DIN female connector
Part No. 370 623

Accessories

	Part No.
Ring magnet OD33, Standard	201 542-2
U-Magnet OD33	251 416-2
Ring magnet OD25,4	400 533
6 pol. female cable connector M16	370 623
O-Ring 21,89 x 2,62	560 705
O-Ring 15,3 x 2,2 FPM	401 133
Backup ring	560 629

From F-No. 0546 xxxx LD-Analogue sensors are adjustable with following servicetools:
 Handheld-Programmer G-Analogue 253 294
 PC-Programmer G-Analogue incl. power supply 253 145
 (100-240 VAC/24 VDC), cable and programming software (CD)

All dimensions in mm

Document Part Number: 05012010e

MTS and Tempsonics® are registered trademarks of MTS Systems Corporation. All other trademarks are the property of their respective owners. Printed in Germany.

Copyright © 2013 MTS Sensor Technologie GmbH & Co. KG. Alterations reserved. All rights reserved in all media. No license of any intellectual property rights is granted. The information is subject to change without notice and replaces all data sheets previously supplied. The availability of components on the market is subject to considerable fluctuation and to accelerated technical progress. Therefore we reserve the right to alter certain components of our products depending on their availability. In the event that product approbations or other circumstances related to your application do not allow a change in components, a continuous supply with unaltered components must be agreed by specific contract.



**MTS Sensor Technologie
GmbH & Co. KG**
Auf dem Schüffel 9
58513 Lüdenscheid, Germany
Tel. + 49-23 51-95 87 0
Fax + 49-23 51-5 64 91
E-Mail: info@mtssensor.de
www.mtssensor.de

MTS Systems Corporation
Sensors Division
3001 Sheldon Drive
Cary, N.C. 27513, USA
Tel. + 1-919-677-0100
Fax + 1-919-677-0200
E-Mail: sensorsinfo@mts.com
www.mtssensors.com

MTS Sensors Technology Corp.
737 Aihara-cho,
Machida-shi, Japan
Tel. + 81-42-775-3838
Fax + 81-42-775-5516
E-Mail: info@mtssensor.co.jp
www.mtssensor.co.jp