

HRTR 55 Ex

Diffuse reflection light scanner with background suppression

en 01-2011/05 50113748




5 ... 400mm
200mm with
black-white error < 10%



- Diffuse reflection light scanner with visible red light and adjustable background suppression
- Stainless steel device housing and protective housing
- Exact scanning range adjustment through 8-turn potentiometer
- Very good black/white behavior and reliable switching nearly independent of the object or background properties
- Fast alignment through *brightVision*®
- A²LS- Active Ambient Light Suppression
- Certification
 Ⓔx II 3G Ex nA op is IIB T4 Gc X
 Ⓔx II 3D Ex tc IIIC T70°C Dc IP67 X


Dimensioned drawing

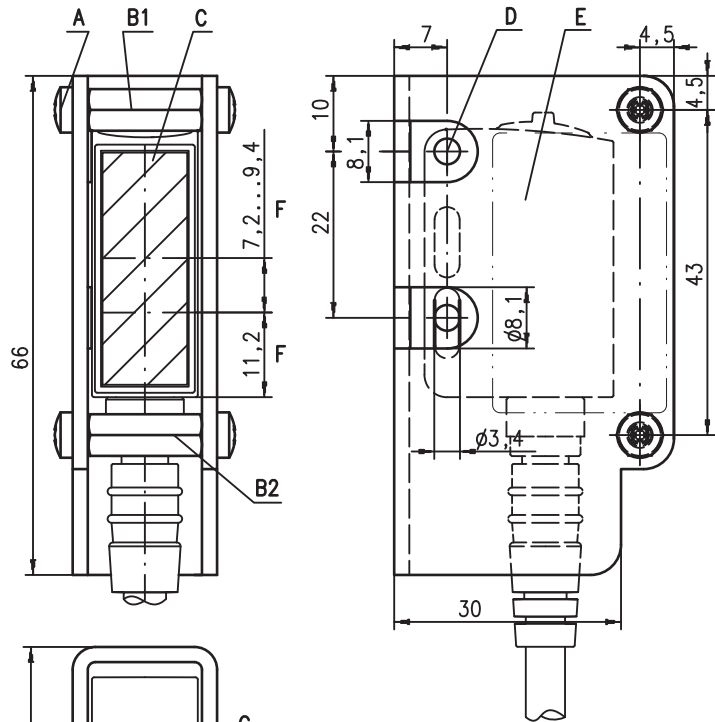

- A** 4x screw M3 x 8
- B1** Distance bolts
- B2** Distance bolts
- C** Sensor Series 55
- D** Attachment holes for M3 x 20 screws
- E** Name plate
- F** Optical axis
- G** Indicator diode

Electrical connection

Plug connection, 4-pin

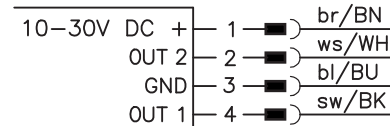

DANGER

- Observe the notices for installation and commissioning!
- Do not disconnect the sensor connection within the potentially explosive area while under voltage!

Accessories:

(available separately)

- Cables with M8 connector



Attention!

Only use cables with axial (straight) plug outlet (see dimensioned drawing).

We reserve the right to make changes • DS_HRTR55_Ex_en.fm



Specifications

Optical data

Typ. scanning range limit ¹⁾	5 ... 400mm
Scanning range ²⁾	see tables
Adjustment range	15 ... 400mm
Light beam characteristic	focussed at 200mm
Light source ³⁾	LED (modulated light)
Wavelength	620nm (visible red light)

Timing

Switching frequency	1000Hz
Response time	0.5ms
Delay before start-up	≤ 300ms (acc. to. IEC 60947-5-2)

Electrical data

Operating voltage U_B	10 ... 30VDC (incl. residual ripple)
Residual ripple	≤ 15% of U_B
Open-circuit current	≤ 15mA
Switching output	.../66 ⁴⁾ 2 push-pull switching outputs pin 2: PNP dark switching, NPN light switching pin 4: PNP light switching, NPN dark switching light/dark switching
Function characteristics	adjustable via 8-turn potentiometer
Signal voltage high/low	$\geq (U_B - 2V) / \leq 2V$
Output current	max. 100mA
Scanning range	

Indicators

Green LED	ready
Yellow LED	object detected - reflection

Mechanical data

Housing	AISI 316L stainless steel, DIN X2CrNiMo17132, W.No 1.4404
Protective housing	stainless steel AISI 303, DIN X8CrNiS18-9, W.Nr 1.4305
Optics cover	coated plastic (PMMA), scratch resistant and non-diffusive
Operation	plastic (TPV - PE), non-diffusive
Weight	with M8 connector: 130g
Connection type	M8 connector 4-pin

Environmental data

Ambient temp. (operation/storage)	-20°C ... +50°C / -30°C ... +70°C
Protective circuit ⁵⁾	2, 3
VDE safety class ⁶⁾	III
Protection class	IP 67
Light source	free group (in accordance with EN 62471)
Standards applied	IEC 60947-5-2

Explosion protection

Labeling (CENELEC)	Ex II 3G Ex nA op is IIB T4 Gc X
	Ex II 3D Ex tc IIIC T70 °C Dc IP67 X

- 1) Typ. scan. range limit: max. achievable scanning range for light objects (white 90%)
- 2) Scanning range: recommended scanning range for objects with different diffuse reflection
- 3) Average life expectancy 100,000h at an ambient temperature of 25°C
- 4) The push-pull switching outputs must not be connected in parallel
- 5) 2=polarity reversal protection, 3=short-circuit protection for all transistor outputs
- 6) Rating voltage 50V

Order guide

	Designation	Part No.
with M8 connector	HRTR 55/66-S8 Ex	50115269




Tables

1	5	400
2	10	300
3	15	200


1	white 90%
2	gray 18%
3	black 6%

Scanning range [mm]

Diagrams

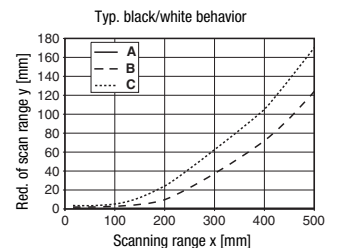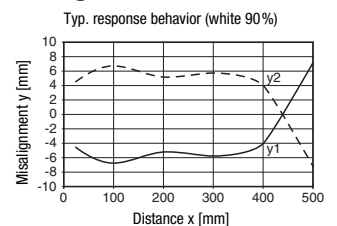

- A white 90%
- B gray 18%
- C black 6%



Remarks

- **Approved purpose**
This product may only be used by qualified personnel and must only be used for the approved purpose. This sensor is not a safety sensor and is not to be used for the protection of persons.
- A list of tested chemicals can be found in the first part of the product description.

Notices for the safe use of sensors in potentially explosive areas

The valid range encompasses devices of Group II, Category 3, Zones 2 ("Gas Ex") and 22 ("Dust Ex").



- Check whether the equipment classification corresponds to the requirements of the application.
- A safe operation is only possible if the equipment is used properly and for its intended purpose.
- Electrical equipment may endanger humans and (where applicable) animal health, and may threaten the safety of goods if used incorrectly or under unfavorable conditions in potentially explosive areas.
- The applicable national regulations (e.g. EN 60079-14) for the configuration and installation of explosion-proof systems must be observed.

Installation and Commissioning

- The devices must only be installed and commissioned by trained electricians. They must be aware of the regulations and operation of explosion-proof equipment.
- Static charge on plastic surfaces must be avoided.
- To prevent unintentional separation under voltage, devices with connector (e.g. Series 46B) must be equipped with a safeguard or a mechanical interlocking guard (e.g. K-V M12-Ex, part no. 50109217). The warning sign "Do not disconnect under voltage" that is supplied with the device must be attached to the sensor or its mounting bracket so that it is clearly visible.
- Devices with terminal compartment lid (e.g. Series 96) must only be commissioned if the terminal compartment lid of the device is properly sealed.
- Connection cables and connectors must be protected from excessive or unintended pulling or pushing strain.
- Prevent dust deposits from forming on the devices.
- Metallic parts (e.g. housing, mounting devices) are to be integrated into the potential equalization to prevent electrostatic charge.

Maintenance

- No changes may be made to explosion-proof devices.
- Repairs may only be performed by persons trained for such work or by the manufacturer.
- Defective devices must be replaced immediately.
- Cyclical maintenance is generally not necessary.
- Depending on the environmental conditions, it may occasionally be necessary to clean the optical surfaces of the sensors. This cleaning must only be performed by persons trained for this task. We recommend using a soft, damp cloth. Cleaning agents that contain solvents must not be used.

Chemical Resistance

- The sensors demonstrate good resistance against diluted (weak) acids and bases.
- Exposure to organic solvents is possible only under certain circumstances and only for short periods of time.
- Resistance to chemicals must be examined on a case by case basis.

Special conditions


- The sensor must be removed from the protective housing in order to connect the M8 connector. After the connection has been established, the sensor must be installed back into the protective housing properly. Operation without protective housing is not permitted.
- If the sensor is connected to the M8 connector and installed properly in the protective housing, the connector can no longer be unintentionally separated. Further mechanical protective measures are therefore not necessary.
- The devices must be installed in such a way that they are protected from direct exposure to UV rays (sunlight).

Application notes




- For glossy surfaces (e.g. metals), the light beam should not be incident on the object surface at a right angle. A slight inclination is sufficient for preventing undesired direct reflections. This may result in a reduction in the scanning range.
- Objects should only be moved in laterally from the right or left. Moving in objects from the connector side or operating side is to be avoided.
- Outside of the scanning range, the sensor operates as an energetic diffuse reflection light scanner. Light objects can still be reliably detected up to the scanning range limit.
- The sensors are equipped with effective measures for the maximum avoidance of mutual interference should they be mounted opposite one another. Opposite mounting of multiple sensors of the same type should, however, absolutely be avoided.



Mounting instructions

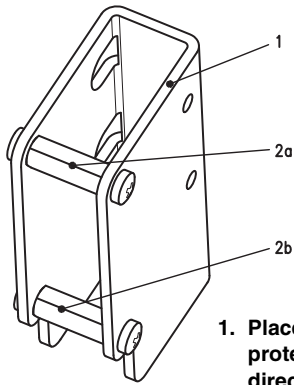


1. Place device in the protective housing in the direction of the arrow.

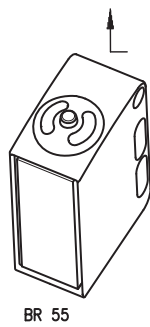

BR 55

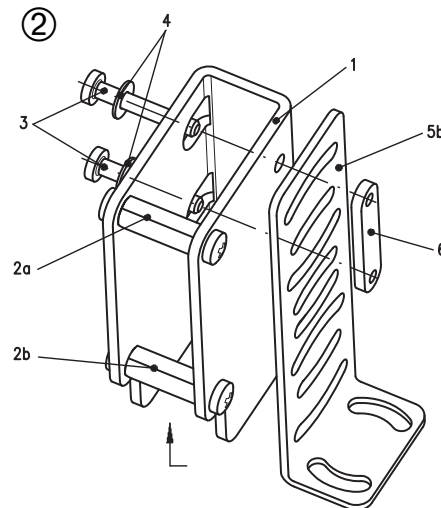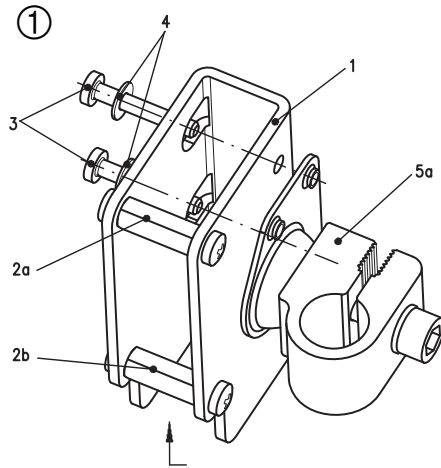

2. Fit fastening screws (item 3) with washers (item 4) according to diagrams ①, ②, ③ depending on the installation situation, push through the device and securely tighten.

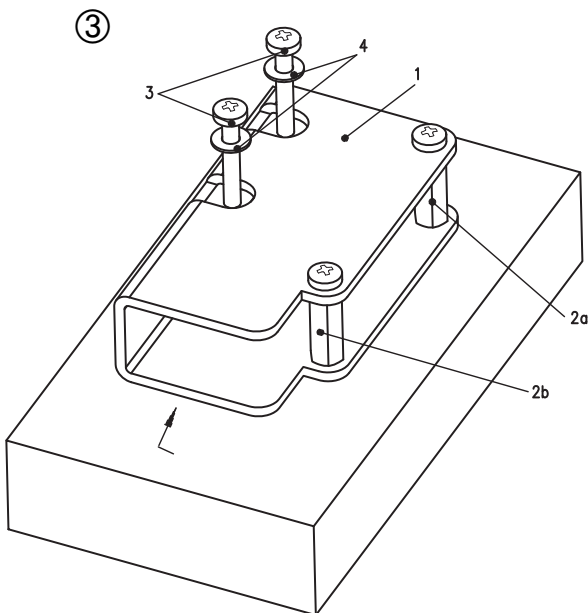

- 1** Protective housing
- 2a, 2b** Distance bolts (mounted)
- 3** Screw M3
- 4** Washer
- 5a, 5b** Mounting devices (e.g. UMS 25, BT 25, ...)
- 6** Plate BT 3

Declaration of Conformity



the **sensor** people

**EG-KONFORMITÄTS-
ERKLÄRUNG**

**EC DECLARATION
OF CONFORMITY**

**DECLARATION CE
DE CONFORMITE**

Der Hersteller

The Manufacturer

Le constructeur

Leuze electronic GmbH + Co. KG
In der Braike 1, PO Box 1111
73277 Owen, Germany

erklärt, dass die nachfolgend aufgeführten Produkte den einschlägigen Anforderungen der genannten EG-Richtlinien und Normen für die Gerätegruppe II und die Gerätekategorie 3 entsprechen.

declares that the following listed products fulfil the relevant provisions of the mentioned EC Directives and standards for equipment group II and equipment category 3.

déclare que les produits identifiés suivants sont conformes aux directives CE et normes mentionnées pour les appareils du groupe II et catégorie 3.

Produktbeschreibung:

Description of product:

Description de produit:

Reflexions-Lichttaster

**Diffuse reflection
light scanners**

Détecteur de réflexion

HRTR 55/... Ex

HRTR 55/... Ex

HRTR 55/... Ex

Kennzeichnung Gas / Staub:

Marking for gas / dust:

Marquage gaz / poussière:

II 3G Ex nA op is IIB T4 Gc X

II 3D Ex tc IIIC T 70°C Dc IP67 X

Angewandte EG-Richtlinie(n):

Applied EC Directive(s):

Directive(s) CE appliquées:

94/9/EG
2004/108/EG

94/9/EC
2004/108/EC

94/9/CE
2004/108/CE

Angewandte Normen:

Applied standards:

Normes appliquées:

EN 60947-5-2:2007
EN 60079-15:2005
EN 60079-31:2009

EN 60079-0:2009
EN 60079-28:2007

Datum / Date / Date

Dr. Harald Grübel, Geschäftsführer / Director / Directeur

Leuze electronic GmbH + Co. KG
In der Braike 1
D-73277 Owen
Telefon +49 (0) 7021 573-0
Telefax +49 (0) 7021 573-199
info@leuze.de
www.leuze.de

Leuze electronic GmbH + Co. KG, Sitz Owen, Registergericht Stuttgart, HRA 230712
Persönlich haftende Gesellschafterin Leuze electronic Geschäftsführungs-GmbH,
Sitz Owen, Registergericht Stuttgart, HRB 230650
Geschäftsführer: Dr. Harald Grübel (Vorsitzender), Karsten Just
USt-IdNr. DE 145912521 | Zollnummer 2554232
Es gelten ausschließlich unsere aktuellen Verkaufs- und Lieferbedingungen
Only our current Terms and Conditions of Sale and Delivery shall apply

LEO-ZQM-149-01-FO