



ACVATIX™

Modulating control valves **MXG461S..** with magnetic actuator, **PN16**

stainless steel

-
- **Fast positioning time (1 s), high-resolution stroke (1 : 1000)**
 - **Selectable valve characteristic: equal-percentage or linear**
 - **High rangeability**
 - **Switch-selected control signal DC 0/2...10 V or DC 4...20 mA**
 - **Wear-free inductive stroke measurement**
 - **Robust, no maintenance required**
 - **Spring-return function: A → AB closed when de-energized**
 - **Positioning control, position feedback and manual control**
 - **Parts in contact with medium in CrNi steel**

Use

The control valves MXG461S.. are mixing or through-port valves. They are supplied with the magnetic actuator ready fitted, equipped with an electronics module for position control and position feedback.

The short positioning time, high resolution and high rangeability make these valves ideal for modulating control of open and closed circuits with the highest control requirements.

Type summary

| Type reference | DN | Connection [inch] | k_{vs} [m ³ /h] | Δp_{max} [kPa] | Δp_s [kPa] | Operating voltage | Positioning | | Spring return function |
|----------------|----|----------------------|---------------------------------|---------------------------|-----------------------|----------------------|-------------|------|---------------------------|
| | | | | | | | signal | time | |
| MXG461S15-1.5 | 15 | G 1B | 1.5 | 300 | 300 | AC 24 V | DC 0...10 V | 1 s | ✓ |
| MXG461S20-5.0 | 20 | G 1¼B | 5.0 | | | | or | | |
| MXG461S25-8.0 | 25 | G 1½B | 8.0 | | | | DC 2...10 V | | |
| MXG461S32-12 | 32 | G 2B | 12 | | | | or | | |

DN = Nominal size.

k_{vs} = Nominal flow rate of cold water (5 to 30 °C) through the fully opened valve (H_{100}) at a differential pressure of 100 kPa (1 bar).

Δp_{max} = Maximum permissible differential pressure across the valve's control path, valid for the entire actuating range of the motorized valve (mixing: path A-AB, B-AB)

Δp_s = Maximum permissible differential pressure at which the motorized valve will close securely against the pressure (close off pressure).

Accessory

| Type reference | Description |
|----------------|--|
| SEZ91.6 | External interface for DC 0...20 V phase cut control signal, refer to data sheet N5143 |

Ordering

Valve body and magnetic actuator form one assembly and cannot be separated.

When placing an order, please specify the quantity, product description and type code.

Example:

| Type reference | Stock number | Description | Quantity |
|----------------|---------------|---|----------|
| MXG461S25-8.0 | MXG461S25-8.0 | Modulating control valve with magnetic actuator | 2 |

Delivery

A CrNi-Stahl seal disc with 3 gaskets is part of the delivery.
Union fittings must be supplied by the installer.

Rev. no.

Overview table, see page 11.

Replacement electronics module ASE1

Should the valve electronics prove faulty, the electronics module must be replaced by the ASE1 replacement electronics module. Mounting instruction no. 35678 is included.

Technical and mechanical design

For a detailed description of operation, refer to data sheet CA1N4028E.

Control operation

The electronics module converts the positioning signal to a phase-cut power signal which generates a magnetic field in the coil. This causes the armature to change its position in accordance with the interacting forces (magnetic field, counter spring, hydraulics). The armature responds rapidly to any change in signal, transferring the corresponding movement directly to the valve plug, enabling fast changes in load to be corrected quickly and accurately.

The valve's position is measured continuously (inductive). The internal positioning controller balances any disturbance in the system rapidly and delivers the position feedback signal. The valve stroke is proportional to the positioning signal.

Control

The magnetic actuator can be driven by a Siemens controller or a controller of other manufacture that deliver a DC 0...10 V, DC 2...10 V or DC 4...20 mA output signal. To achieve optimum control performance, it is recommended to use a 4-wire connection.


Spring return function

If the positioning signal is interrupted, or in the event of a power failure, the valve's return spring will automatically close control path A → AB.

Manual control

MANUAL

The valve control path (ports A → AB) can be opened manually to between 80...90 % of the full stroke (depending on DN) by pressing the hand wheel inwards and turning it clockwise (MANUAL setting). This disables the control signal from the controller, the green LED is flashing.

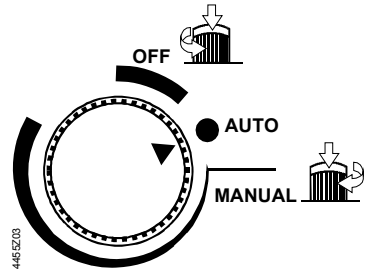


OFF

To disable automatic control of the valve, press the hand wheel inwards and turn it anti-clockwise (to the OFF position). The valve will close, the green LED is flashing.


AUTO

For automatic control, the hand wheel must be set to the AUTO position (the hand wheel will spring out), the green LED is lit.


Operator controls and indicators in the electronics housing

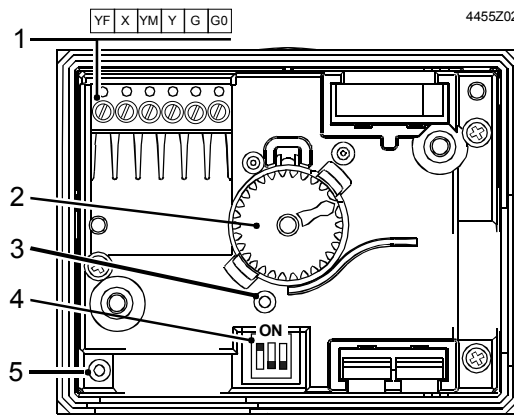


- 1 Connection terminals
- 2 Hand wheel
- 3 Opening for auto calibration
- 4 DIL switch for mode control

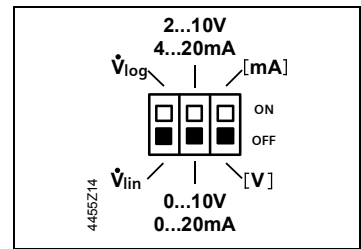

- 5 LED for indication of operating stat

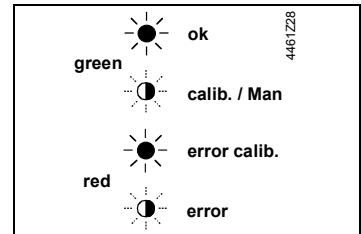


Configuration DIL switch









| Switch | Function | ON / OFF | Description |
|--------|----------------------|----------|--|
| 1 | Valve characteristic | ON | \dot{V}_{log} (equal percentage) |
| | | OFF | \dot{V}_{lin} (linear) ¹⁾ |
| 2 | Positioning signal Y | ON | DC 2...10 V, DC 4...20 mA |
| | | OFF | DC 0...10 V ¹⁾ |
| 3 | [V] or [mA] | ON | [mA] |
| | | OFF | [V] ¹⁾ |

1) Factory setting

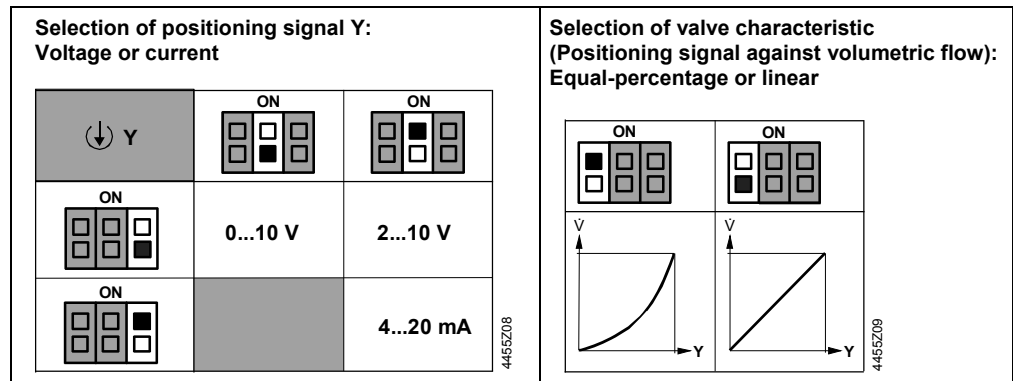

Forced control input

| | | YF – Function | | |
|------------|---|--|---|---|
| | | no function | fully open | closed |
| Connection |  |  |  | |
| | |  |  |  |
| Function | | <ul style="list-style-type: none"> YF not wired Valve follows Y signal | <ul style="list-style-type: none"> YF connected with G Valve fully opens above A → AB | <ul style="list-style-type: none"> YF connected with G0 Valve closes above A → AB |

Signal priority

1. Hand wheel position MANUAL (open) or OFF (closed)
2. Forced control signal YF
3. Signal input Y

Calibration


The MXG461S.. magnetic valves are factory-calibrated at 0 % and 100 % stroke.

When commissioning the valves, however, (especially under extreme conditions of use) there may still be some leakage via control path A → AB with a 0 % stroke control signal (DC 0 V, DC 2 V or DC 4 mA).

In this case, the valve can be recalibrated simply and quickly:



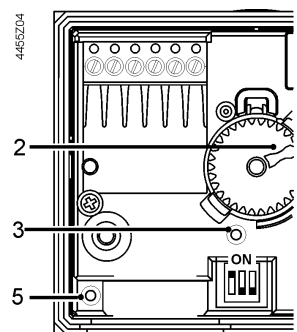


1. Set hand wheel [2] in AUTO-position.
2. Activate calibration using a pointed pin (ø 2 mm) by pressing the button in the opening [3] once.
3. While recalibration is in progress, the LED [5] is flashing green for approximately 10 seconds.
The valve will be briefly closed and fully opened.

If the electronics module is replaced, the valve's electronics must be recalibrated. For that, the hand wheel must be set to AUTO.



Indication of operating state


The two-color LED display indicating operating status can be viewed by opening the cover of the electronics module.

| LED | Indication | Function | Remarks, troubleshooting |
|-------|--|---------------------------------------|---|
| Green | Lit  | Control mode | Automatic operation; everything o.k. |
| | Flashing  | Calibration In manual control | Wait until calibration is finished (green or red LED will be lit) Hand wheel in MANUAL or OFF position |
| Red | Lit  | Calibration error Internal error | Recalibrate (operate button in opening 1x) Replace electronics module |
| | Flashing  | Mains fault | Check mains network (frequency or voltage outside operating range) |
| Both | Dark  | No power supply Electronics faulty | Check mains network, check wiring Replace electronics module |

As a general rule, the LED can assume only the states shown above (continuously red or green, flashing red or green, or both off).

Sizing

Flow chart

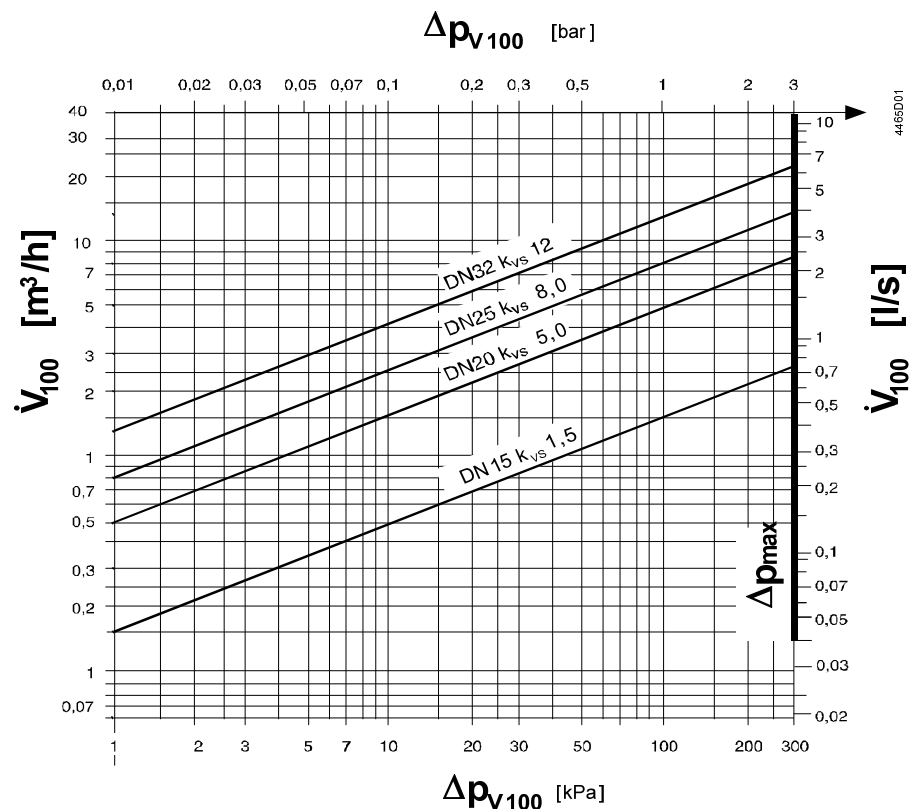

Δp_{v100} = differential pressure across the fully open valve and the valve's control path by a volume flow V_{100}

V_{100} = volumetric flow with valve fully open (H_{100})

Δp_{max} = maximum permissible differential pressure across the valve's control path, valid for the entire actuating range of the motorized valve (mixing: path A-AB, B-AB)


100 kPa = 1 bar \approx 10 mWC

1 m^3/h = 0.278 l/s water at 20 °C

Valve characteristic


Equal percentage

Volumetric flow

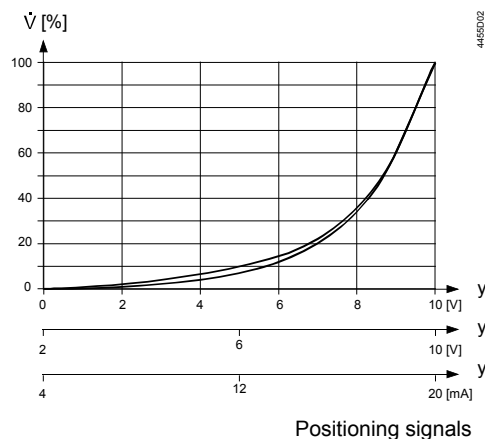

Linear

Volumetric flow

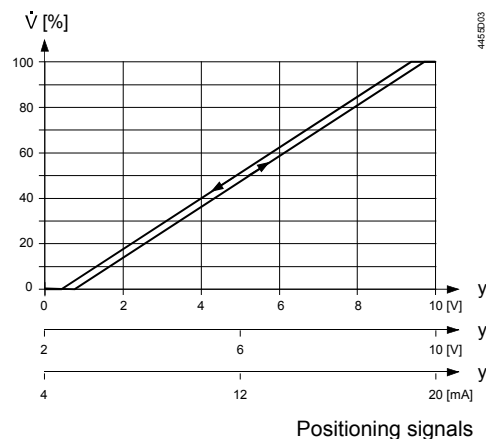

Connection type ¹⁾

The 4-wire connection should always be given preference!

4-wire connection

| Type reference | S_{NA} [VA] | P_{MED} [W] | S_{TR} [VA] | I_F [A] | wire cross-section [mm ²] | | |
|----------------|------------------|------------------|------------------|--------------|---------------------------------------|-----|-----|
| | | | | | 1,5 | 2,5 | 4,0 |
| MXG461S15-1.5 | 29 | 5 | 50 | 3,15 | max. cable length L [m] | | |
| MXG461S20-5.0 | | | | | 70 | 110 | 170 |
| MXG461S25-8.0 | | | | | | | |
| MXG461S32-12 | | | | | | | |

S_{NA} = nominal apparent power for selecting the transformer

P_{med} = typical power consumption

S_{TR} = Minimal required transformer power

I_N = required slow fuse

L = max. cable length; with 4-wire connections, the max. permissible length of the separate 1.5 mm² copper positioning signal wire is 200 m

¹⁾ All information at AC 24 V

Engineering notes

Conduct the electric connections in accordance with local regulations on electric installations as well as the internal or connection diagrams.



Safety regulations and restrictions designed to ensure the safety of people and property must be observed at all times!



In open circuits, there is a risk of valve disc seizing caused by scale deposits. Additionally, periodic actuation (twice or three times per week) must be planned.



With closed and open circuits always use a strainer upstream of the valve to increase the valve's functional safety.


Mounting notes

Mounting and operating instructions are printed on the actuator and on the electronics module.

Caution

The valve may only be used as a mixing or through-port valve, not as a diverting valve. Observe the direction A → AB of flow!

Orientation



Degree of protection valid only with M20 cable gland supplied by the installer.

Access for installation

It is essential to maintain the specified minimum clearance above and to the side of the actuator and/or electronics module! (refer to «Dimensions», page 11).

Use as straight-through valves


Only three-way MXG461S.. valves are supplied. They may be used as straight-through valves by closing off port «B».

MXG461S.. threaded valves in straight-through applications

Close off port B with a union fitting.

A CrNi-Steel seal disc with 3 gaskets is part of the delivery.

Union fittings conforming to ISO 49 / DIN 2950 must be supplied by the installer.



Installation notes



- Do not use hemp for sealing the valve body threads.
- The actuator may not be lagged.
- The MXG461S.. valves are flat-faced allowing sealing with three gaskets provided.
- For notes on electrical installation, see «Connection diagram», page 9.

Maintenance notes

The valves and actuators are maintenance-free.

The low friction and robust design make regular servicing unnecessary and ensure a long service life. The valve stem is sealed from external influences by a maintenance-free gland.

If the red LED is lit, the electronics must be recalibrated or replaced.

Repair

Should the valve electronics prove faulty, the electronics module must be replaced by the ASE1 replacement electronics module. Mounting Instruction no 35678 is included.




Always disconnect power before fitting or removing the electronics module.

After replacing the electronics module, calibration must be triggered in order to optimally match the electronics to the valve (refer to «Calibration», page 4).



Under operating conditions within the limits defined by the application data, the actuator will become hot, but this does not represent a burn risk. Always maintain the minimum clearance specified, refer to «Dimensions», page 11.

Disposal



The actuator must not be disposed of together with domestic waste. This applies in particular to the PCB.

Legislation may demand special handling of certain components, or it may be sensible from an ecological point of view.

Current local legislation must be observed.

Warranty

Application-specific technical data must be observed.

If specified limits are not observed, Siemens Switzerland Ltd / HVAC Products will not assume any responsibility.

Valve body, magnetic coil and steel bracket form one integral unit. Dismantling destroys the magnetic valve.

Technical data

Functional actuator data

| | | |
|------------------------|---|---|
| Power supply | Extra low-voltage only (SELV, PELV) | |
| | Operating voltage | AC 24 V, +20 / -15 % |
| | Frequency | 45...65 Hz |
| | Typical power consumption P_{MED} | 5 W |
| | Stand by | < 2 W (valve closed) |
| | Apparent power S_A | 29 VA |
| | Min. power of transformer S_{TR} | 50 VA |
| | Required fuse I_F | 3,15 A, slow |
| Input | Positioning signal Y | DC 0/2...10 V or DC 4...20 mA |
| | Impedance | DC 0/2...10 V 100 k Ω // 5nF (load < 0.1 mA) |
| | | DC 4...20 mA 100 Ω // 5nF |
| | Forced control YF | |
| | Impedance | 22 k Ω |
| | Close valve (YF connected to G0) | < AC 1 V |
| | Open valve (YF connected to G) | > AC 6 V |
| | no function (YF not wired) | positioning signal Y active |
| Output | Position feedback signal X | DC 0...10 V; load resistance > 5 k Ω |
| | Max. load | 2 mA // 100 pF |
| | Stroke measurement | Inductive |
| | Nonlinearity | \pm 3 % of end value |
| Positioning time | Positioning time | < 1 s |
| Electrical connections | Cable entry point | 2 x \varnothing 20.5 mm (for M20) |
| | Connecting terminal | Screwing terminal for 4 mm ² wire |
| | Min. wire cross-section | 1.5 mm ² |
| | Max. cable length | refer to «Connection type», page 6 |
| Functional data valve | PN class | PN 16 as per EN 1333 |
| | Permissible operating pressure | 1 MPa (10 bar) |
| | Differential pressure $\Delta p_{max} / \Delta p_s$ | refer to table «Type summary», page 2 |
| | Valve characteristic ¹⁾ | equal percentage or linear, $n_{gl} = 5$ as per VDI / VDE 2173, optimized near the closing point |
| | Leakage rate at $\Delta p = 0.1$ MPa (1 bar) | A \rightarrow AB < 0.02 % of k_{VS} value B \rightarrow AB < 0.2 % k_{VS} depending on operation conditions |
| | Permissible media | chilled, cold and hot water, water with anti-freeze; recommendation: water treatment as per VDI 2035 |
| | Medium temperature | 1...130 °C |
| | Stroke resolution $\Delta H / H_{100}$ | 1 : 1000 (H = Hub) |
| | Hysteresis | typical 3 % |
| | Position when de-energized | A \rightarrow AB closed |
| | Mounting position | upright to horizontal (observe safety standard) |
| | Mode of operation | Modulating |
| | Manual operation | Possible, max. 90 % |
| Materials | Valve body | CrNi high-grade steel cast (no. 1.4581) |
| | Seat, inner valve, plug | CrNi steel |
| | Entire inner suit | CrNi steel |
| | Valve stem seal | EPDM (O-ring) |
| Dimensions / weight | Dimensions | refer to «Dimensions», page 11 |
| | Weight | refer to «Dimensions», page 11 |
| | Threaded connection | as per ISO 228-1 |
| Norms and standards | CE-conformity | |

| | |
|--|---|
| to EMV-requirements | 2004/108/EC |
| Immunity | EN 60730-1:2000/A16:2007 ²⁾ |
| Emission | EN 60730-1:2000/A16:2007 |
| Electrical safety | EN 60730-1 |
| Protection class | Class III as per EN 60730 |
| Emissions | Class 2 as per EN 60730 |
| Housing protection upright to horizontal | IP54 as per EN 60529 |
| Vibration ³⁾ | EN 60068-2-6 (1 g acceleration, 1...100 Hz, 10 min) |
| Conforming to | UL standards UL 873 CSA, Canada C22.2 No. 24 C-tick N 474 |
| Environmental compatibility | ISO 14001 (Environment) ISO 9001 (Quality) SN 36350 (Environmentally compatible products) RL 2002/95/EC (RoHS) |
| Pressure Equipment Directive | PED 97/23/EC |
| Pressure accessories | as per Article 1, paragraph 2.1.4 |
| Fluid group 2 | without CE-marking as per article 3, section 3 (sound engineering practice) |

¹⁾ Can be selected via DIL switch.


²⁾ Transformer 160 VA (e.g. Siemens 4AM 3842-4TN00-0EA0).

³⁾ In case of strong vibrations, use high-flex stranded wires for safety reasons.

General environmental conditions

| | Operation EN 60721-3-3 | Transport EN 60721-3-2 | Storage EN 60721-3-1 |
|------------------------------|---------------------------|---------------------------|-------------------------|
| Climatic conditions | Class 3K5 | Class 2K3 | Class 1K3 |
| Temperature | -5...+45 °C | -25...+70 °C | -5...+45 °C |
| Humidity | 5...95 % r.h. | < 95 % r.h. | 5...95 % r.h. |
| Mechanical conditions | | Class 2M2 | Class 1M2 |
| Biological requirements | Class 3B2 | | |
| Chemical active Substances | Class 3C1 | | |
| Mechanical active substances | Class 3M2 | | |


Connection terminals

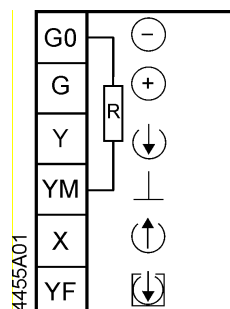

| | |
|---------------------------|------------------------------------|
| AC 24 V operating voltage | System neutral |
| | System potential |
| Positioning signal | DC 0...10 V / 2...10 V / 4...20 mA |
| | Measuring neutral (= G0) |
| Position feedback signal | DC 0...10 V |
| Force control input | |


R = Inner resistance between G0 and YM, approx 10 kΩ

Connection diagrams

Caution  If controller and valve receive their power from separate sources, only one transformer may be earthed on the secondary side.


Terminal assignment for controller with 4-wire connection (to be preferred!)

Common transformer

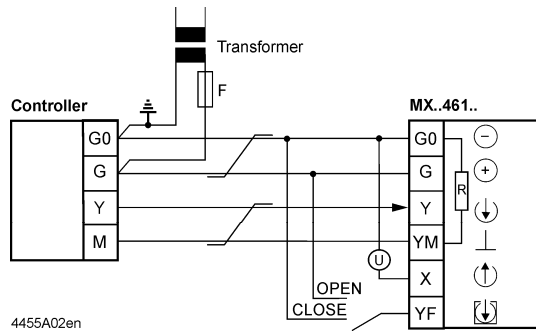

4455A02en


Separate transformer

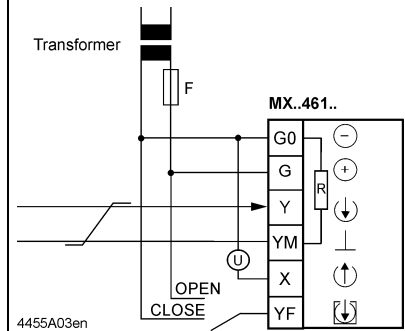

4455A03en


Terminal assignment for controller with 3-wire connection

Common transformer

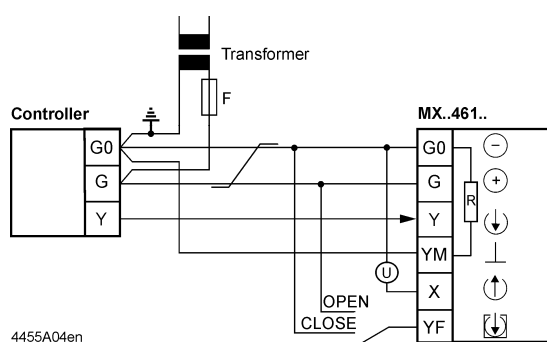



4455A04en

Separate transformer

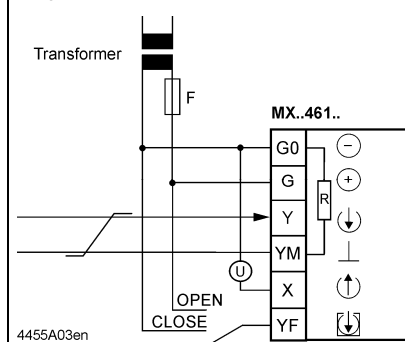

4455A03en

-  Indication of valve position (only if required). DC 0 ...10 V → 0...100 % volumetric flow V_{100}
-  Twisted pairs. If the lines for AC 24 V power supply and the DC 0...10 V (DC 2...10 V, DC 4... 20 mA) positioning signal are routed separately, the AC 24 V line need not be twisted.

Warning

Piping must be connected to potential earth!

DIL switch

Factory setting: Valve characteristics 'linear', positioning signal DC 0...10 V.
Details see «Configuration DIL switches», page 4.


Calibration

See «Calibration», page 5

Dimensions

Threaded MXG461S.. valves with electronics housing

Dimensions in mm

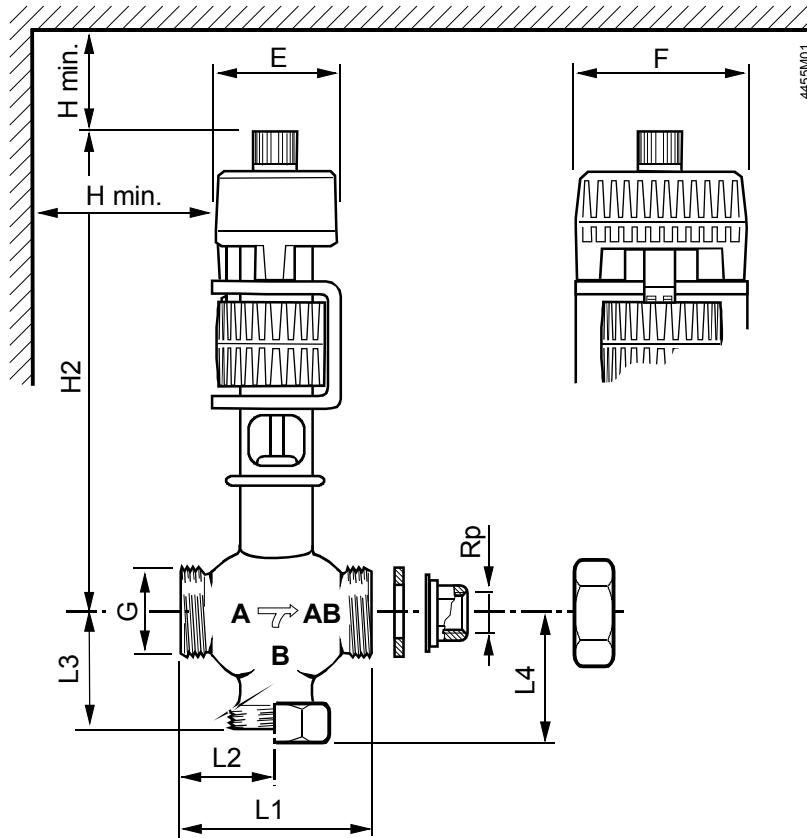

| Type reference | DN | Rp [Inch] | G [Inch] | L1 | L2 | L3 * | L4 | H2 | H min. | E | F | G [kg] |
|----------------|----|--------------|-------------|-----|------|------|----|-----|-----------|----|-----|-----------|
| MXG461S15-1.5 | 15 | Rp 1/2 | G 1B | 80 | 40 | 42.5 | 51 | 240 | 100 | 80 | 100 | 3.8 |
| MXG461S20-5.0 | 20 | Rp 3/4 | G 1 1/4 B | 95 | 47.5 | 52.5 | 61 | 260 | | | | 4.2 |
| MXG461S25-8.0 | 25 | Rp 1 | G 1 1/2 B | 110 | 55 | 56.5 | 65 | 270 | | | | 4.7 |
| MXG461S32-12 | 32 | Rp 1 1/4 | G 2B | 125 | 62.5 | 67.5 | 76 | 285 | | | | 5.6 |

- Externally threaded G...B to ISO 228-1
- Internally threaded Rp... to ISO 7-1
- Union fittings to ISO 49 / DIN 2950

* When used as a through-port valve
G weight in kg (incl. packaging)

Revision numbers

| Type reference | Valid from rev. No. |
|----------------|---------------------|
| MXG461S15-1.5 | ..A |
| MXG461S20-5.0 | ..B |
| MXG461S25-8.0 | ..A |
| MXG461S32-12 | ..A |

